

Full redundant sensor for safety applications

QG40N-KIXv-090-2AI-PT

Inclination sensor for safety applications

1 axis vertical mounting

Programmable device
Output: 4 - 20 mA redundant

full redundant in one housing
non-redundant power lines

Measuring range
 $\pm 90^\circ$



General specifications 12310, v20210611


Housing	Plastic injection molded housing (Arnite T06 202 PBT black)
Dimensions (indicative)	40x40x25 mm
Mounting	Included: 2x M3x25 mm zinc plated steel pozidrive pan head screws, self-tapping (PZ DIN 7500CZ)
Ingress Protection (IEC 60529)	IP67
Relative humidity	0 - 95% (non condensing, housing fully potted)
Weight	approx. 45 gram (cable excluded)
Supply voltage	10 - 30 V dc
Polarity protection	Yes
Current consumption	≤ 30 mA (excluding output signal)
Operating temperature	-40 .. +80 °C
Storage temperature	-40 .. +80 °C
Measuring range	$\pm 90^\circ$
Centering function	Yes (12 mA = 0°), range 360°
Frequency response (-3dB)	0 - 10 Hz
Accuracy (overall @20°C)	0,5° typ.
Offset error	$\pm 0,2^\circ$ typ. after centering
Non linearity	$\pm 0,4^\circ$ typ.
Sensitivity error	not applicable. Repeatability 0,2°
Resolution	0,1°
Temperature coefficient	$\pm 0,04^\circ/\text{K}$ typ.
Max mechanical shock	10.000g
Output	4 - 20 mA / 20 - 4 mA
Output load	Rload $\leq (50 \cdot V_s - 300)$ (Ω) (Eg: $V_s = 24$ V: Rload $\leq 900 \Omega$)
Short circuit protection	Yes (T<55°C), Max 10 s (T>55°C)
Output refresh rate	20 ms
Programming options	by optional QG40N-configurator + brakeout cable (measuring range, filtering).

QG series

QG40N-KIXv-090-2AI-PT


$lout1 = 12 + 8 \cdot (\alpha/90)$ [mA]
 $lout2 = 12 - 8 \cdot (\alpha/90)$ [mA]

Centering: eliminate mech. offsets
 Connect center input to ground (>0,5sec) within 1 min. after power up. Normally the center input should be left unconnected.
 Centering: both channels individually

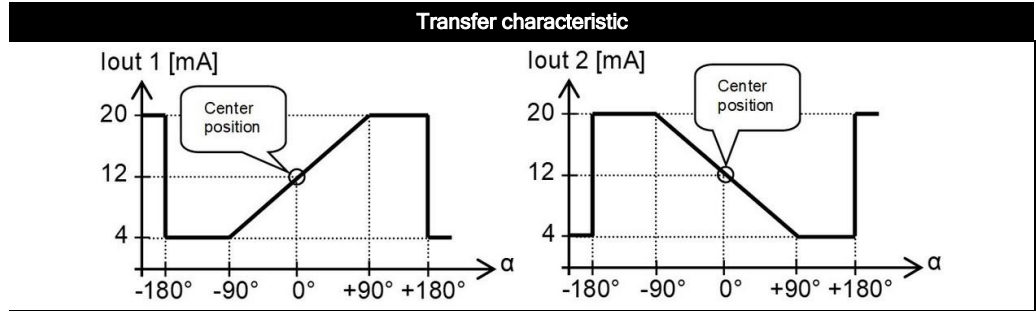

Rotation in vertical plane.
 Turning towards "+x" from 0° :
 $lout1$ increasing, $lout2$ decreasing

Lateral tilt sensitivity error:
 $< \pm 0,03^\circ$ lateral tilt (typ.)
 Max. lateral tilt: 45°

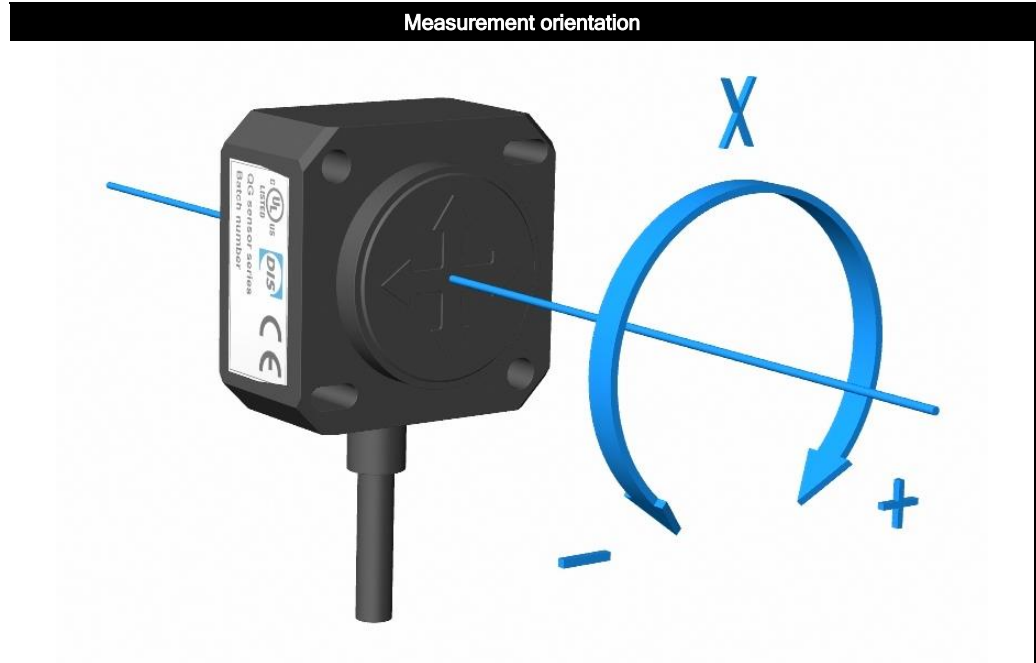


Connection
Wire / pin coding

Connectivity (cable length $\pm 10\%$)

2 m PUR/TPE Li12y11y, black \varnothing 5,2 mm, wires: 6x0,34 mm² DIN colors

Brown	+ Supply Voltage 1 & 2
Grey	Output 1
White	Center 1
Green	GND 1 & 2
Yellow	Output 2
Pink	Center 2

Mechanical dimensions (indicative only)

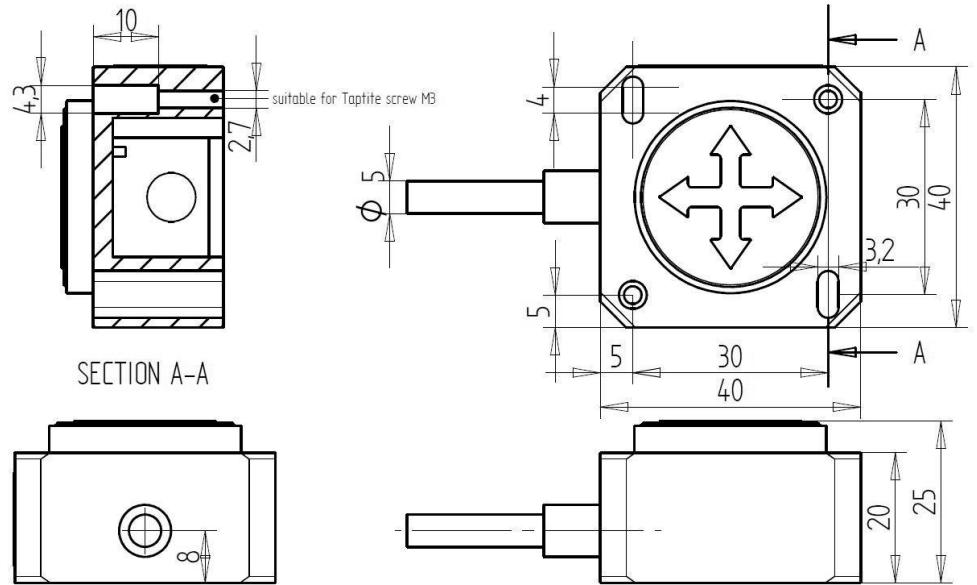

Functional safety, Intended use, Remarks

Functional Safety information:

- This is not a safety device according to European Standard EN ISO 13849-1
- This sensor can be used in safety applications, by taking both sensor outputs into account, compare these outputs and program an algorithm that brings the application into safe state if the difference between the two sensor outputs exceeds the limit appropriate for the application. Judgement whether this device can be used as safety device in customers application or not is the solely responsibility of the customer involved. Calculations can be based on the MTTFd and DC values specified in this datasheet
- MTTFd = 690 year for each individual output
- Diagnostic Coverage (DC) = 0% for each individual output

This is a full redundant device. All components (including MEMS-chip, μ C and Voltage regulator) are redundant, except the powerlines. The device consists of two separate sensors in one housing, with combined power lines.

Hardware architecture for each individual output: CAT.1

Connectivity options:

The Vcc / Gnd can be connected separate or combined (internal T-junction).

standard: 6-wire cable (combined Vcc and combined Gnd): ordering code QG40N-KIXv-090-2AI-PT
 optional: 8-wire cable (separate Vcc and separate Gnd): ordering code QG40N-KIXv-090S-2AI-PT

QG series sensors are intended to measure inclination/acceleration/tilt. Flawless function (acc. spec.) is ensured only when used within specifications. Modifications or non-approved use will result in loss of warranty and void any claims against the manufacturer.

As this device is accelerometer-based the sensor is inherent sensitive for accelerations/vibrations. Application specific testing must be carried out to check whether this sensor will fulfil your requirements.

A Declaration of conformity is available on www.dis-sensors.com/downloads